


PLAN

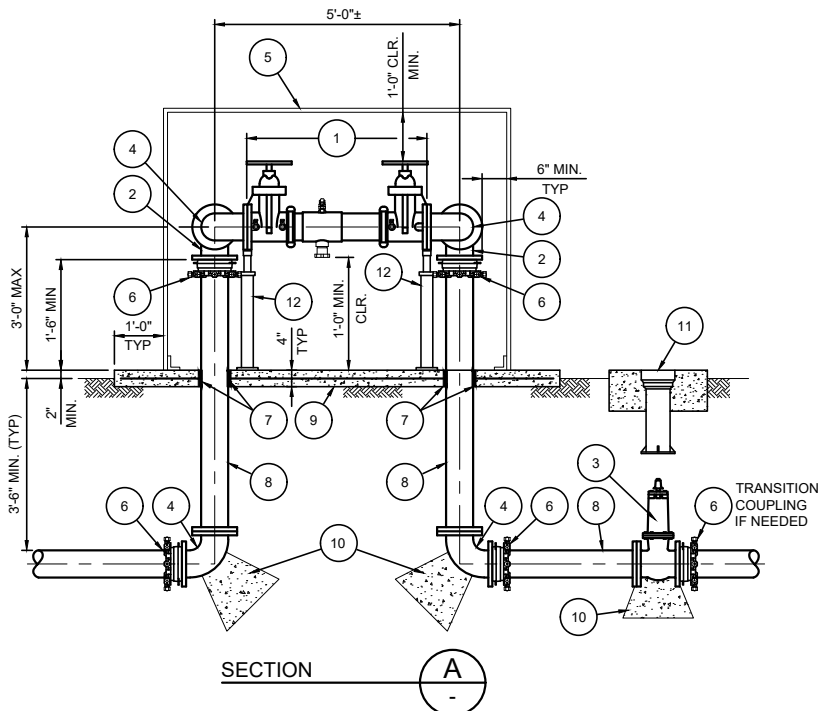

SECTION

DESIGNER/ENGINEER NOTES:

1. PRIOR TO SELECTION OF METER/BACKFLOW ASSEMBLY DETAIL ENGINEER TO VERIFY EXISTING METER AND BACKFLOW CAPACITY, FIRE FLOW AND EXISTING PRESSURE AT THE ASSEMBLY INSTALLATION LOCATION.
2. BASED ON RESEARCH RESULTS, IF MORE THAN ONE STANDARD METER/BACKFLOW ASSEMBLY OR MANUFACTURERS MAY BE UTILIZED THEN ALL APPLICABLE DETAILS ARE TO BE SHOWN ON THE DRAWINGS FOR CONTRACTOR SELECTION.
3. ALL ASSEMBLY PIPING, CONNECTIONS AND EASEMENT SIZES TO ACCOMMODATE THE LARGEST LAYOUT OPTION REGARDLESS OF CONTRACTOR SELECTION TO AVOID CONFLICTS DURING CONSTRUCTION.

REMOVE THESE NOTES WHEN DETAIL USED

MATERIAL LIST

| NO. | DESCRIPTION |
|-----|--|
| 1 | 6" AMES COLT 500 REDUCED PRESSURE DETECTOR (RPDA) BACKFLOW ASSEMBLY OR APPROVED EQUAL (NOTE 2) |
| 2 | 6" FLG TEE |
| 3 | 6" FLG GATE VALVE |
| 4 | 6" FLG 90° BEND |
| 5 | APPROVED ENCLOSURE (CONTRACTOR TO SUBMIT SHOP DRAWINGS) |
| 6 | 6" ADAPTER FLANGE (RESTRAINED) |
| 7 | 1/2" EXPANSION JOINT MATERIAL |
| 8 | 6" FLG x PE DUCTILE IRON PIPE (CUT TO FIT) |
| 9 | CONCRETE PAD WITH WELDED WIRE FABRIC, 4 x 4 - W1.4 x W1.4 |
| 10 | CONCRETE THRUST/ANCHOR BLOCK |
| 11 | VALVE BOX AND COLLAR (NOTE 1) |
| 12 | ADJUSTABLE PIPE SUPPORT |

INSTALLATION NOTES:

1. CONTRACTOR TO INSTALL VALVE LOCK DEVICE WITH DISTRICT PROVIDED LOCK (AS REQUIRED).
2. APPROVED EQUAL MATERIALS CAN BE FOUND ON THE LVVWD APPROVED PRODUCTS LIST.
3. 1'-0" MIN CLEARANCE IS REQUIRED FROM THE RELIEF VALVE TO ASSEMBLY PAD. ASSEMBLY PAD FINISHED GRADE MUST BE AT OR ABOVE HIGH-WATER LEVEL OF SURROUNDING AREA.

6" DUAL COLT 500 REDUCED PRESSURE DETECTOR ASSEMBLY

SCALE: 1/2" = 1'-0"

(USE NRS GATE VALVES ONLY)

BF02-4 030125

