


1/2" PREMOLDED EXPANSION
JOINT WHERE FIRE HYDRANT
PAD IS SET AGAINST EXISTING
CONCRETE AND AROUND FIRE
HYDRANT BARREL

NOTE:
FOR LOCATION OF FIRE HYDRANTS,
AND FIRE HYDRANT PADS. SEE
(PL15-2)



DESIGNER NOTE:
SEE PL15-5 FOR FIRE HYDRANT
NOTES. DESIGNER NOTES TO BE
DELETED FROM DRAWING

PAD DETAIL

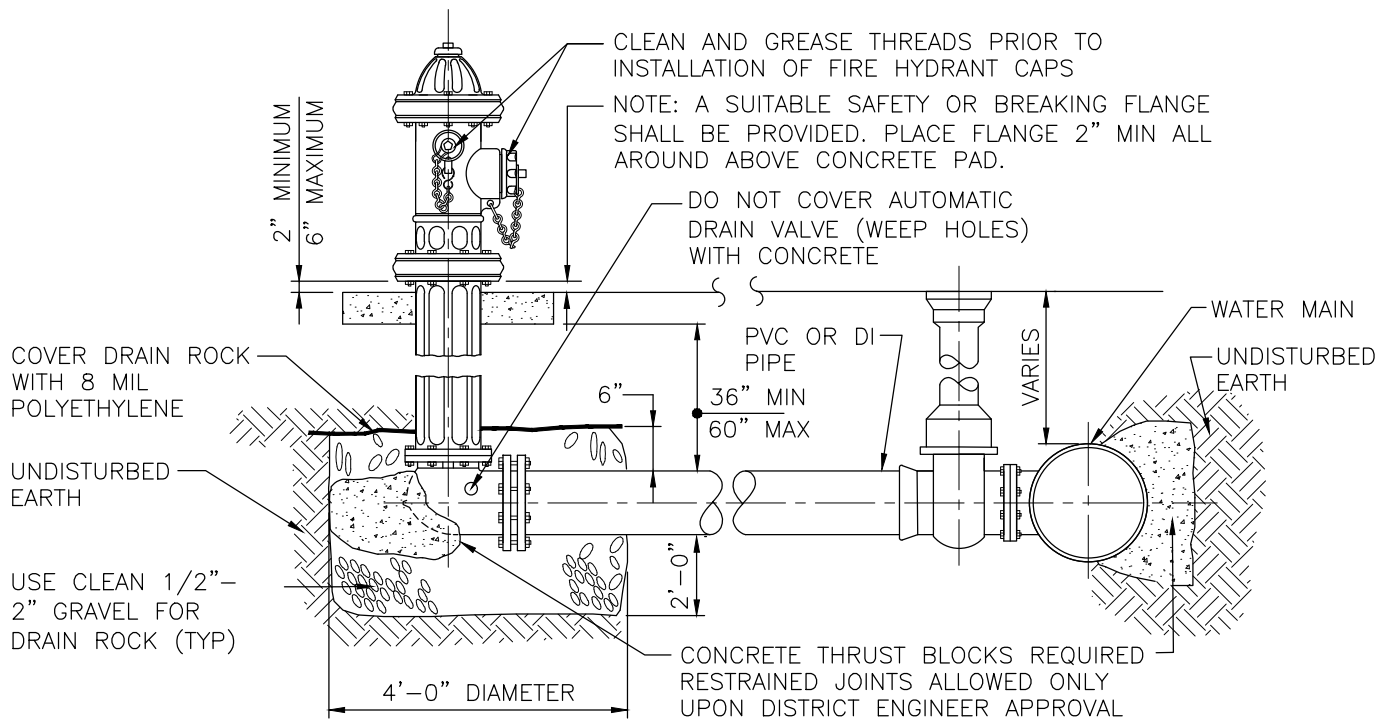

HYDRANT ASSEMBLY DETAIL

FIRE HYDRANT INSTALLATION

NOT TO SCALE

PL15-1

041823

