




(FIGURE 1)

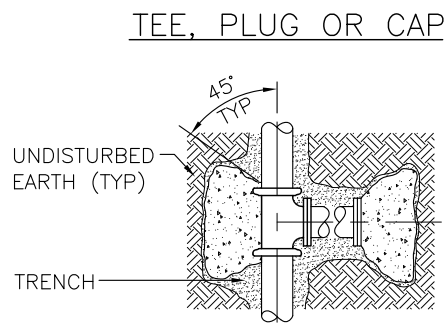

(FIGURE 2)

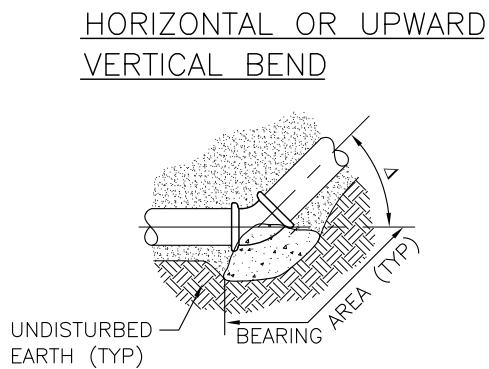

(FIGURE 3)

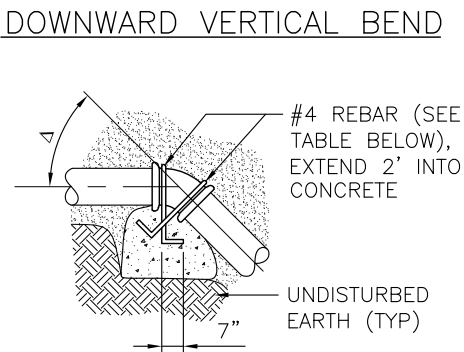

(FIGURE 4)

**NOTE:**

COAT AND WRAP ALL METAL SURFACES IN ACCORDANCE WITH SECTION 09 96 00 OF THE LVVWD SPECS, PROTECTIVE COATINGS. ALL CONCRETE SHALL BE 4,500 PSI MINIMUM, 28 DAYS COMPRESSIVE STRENGTH. CONCRETE IS TO BE PLACED AGAINST UNDISTURBED EARTH. TABLE BELOW DENOTES MINIMUM BEARING AREA OR VOLUME OF THRUST BLOCK. SPECIAL DESIGN CALCULATIONS ARE TO BE SUBMITTED TO LVVWD FOR APPROVAL IF ALLOWABLE SOIL BEARING CAPACITY IS LESS THAN 3000 PSF. ALL VERTICAL SURFACES NOT BEARING AGAINST UNDISTURBED EARTH SHALL BE FORMED.

PIPE ID	BEARING AREA IN SQ FT						CONC/CU YDS		
	FIGURE 1	FIGURE 2	FIGURE 3, $\Delta$				FIGURE 4, $\Delta$		
	1	2	90°	45°	22 $\frac{1}{2}$ °	11 $\frac{1}{4}$ °	45°	22 $\frac{1}{2}$ °	11 $\frac{1}{4}$ °
4"	2	2	2	2	1	1	1.0	0.5	0.5
6"	2	3	4	2	1	1	1.5	1.0	0.5
8"	3	5	7	4	2	1	3.0	1.5	1.0
10"	4	8	11	6	3	2	4.0	2.5	1.5
12"	6	11	15	8	4	2	6.0	3.0	1.5
16"	10	20	28	15	8	4	10.5 *	6.0	3.0
18"	13	25	35	19	10	5	13.5 *	7.5	3.5
20"	16	31	44	24	12	6	16.0 **	9.0	4.5
24"	22	44	63	34	17	9	23.5 **	12.5 *	6.5

\* #5 REBAR \*\* #6 REBAR

**NOTE:**

USE OF THRUST BLOCKS FOR PIPE DIAMETERS GREATER THAN 12" REQUIRES PRIOR DISTRICT APPROVAL AND WILL BE EVALUATED ON A CASE BY CASE BASIS.

## THRUST BLOCK INSTALLATION

NOT TO SCALE

PL11-1 071822

