

SEE PL02-4 FOR DESC.
AND NOTES. FREEZE TEXT5
LAYER TO REMOVE THIS NOTE.

CLSM REQUIREMENTS:

12" MIN DEPTH FOR RIGHT-OF-WAY EQUAL TO OR
GREATER THAN 60' AND LESS THAN 80'

24" MIN DEPTH FOR RIGHT-OF-WAY GREATER THAN 80'

NOT REQUIRED FOR TRENCH WIDTHS GREATER THAN 3'


RESIDENTIAL STREETS AND TRENCH WIDTHS
GREATER THAN 3' (CLSM NOT REQUIRED). THE
TRENCH BACKFILL SHALL EXTEND TO THE TOP OF
THE SUBGRADE MINUS 1" AND THE DEPTH OF
AGGREGATE BASE SHALL MATCH EXISTING BASE
DEPTH (AT 95% COMPACTION)

PAVEMENT
REPLACEMENT LIMITS
AS SHOWN ON PLANS

REMOVE AND REPLACE
EXISTING PAVEMENT,
MATCH EXISTING
DEPTH PLUS 1"

EXIST PAVEMENT

EXIST PAVEMENT

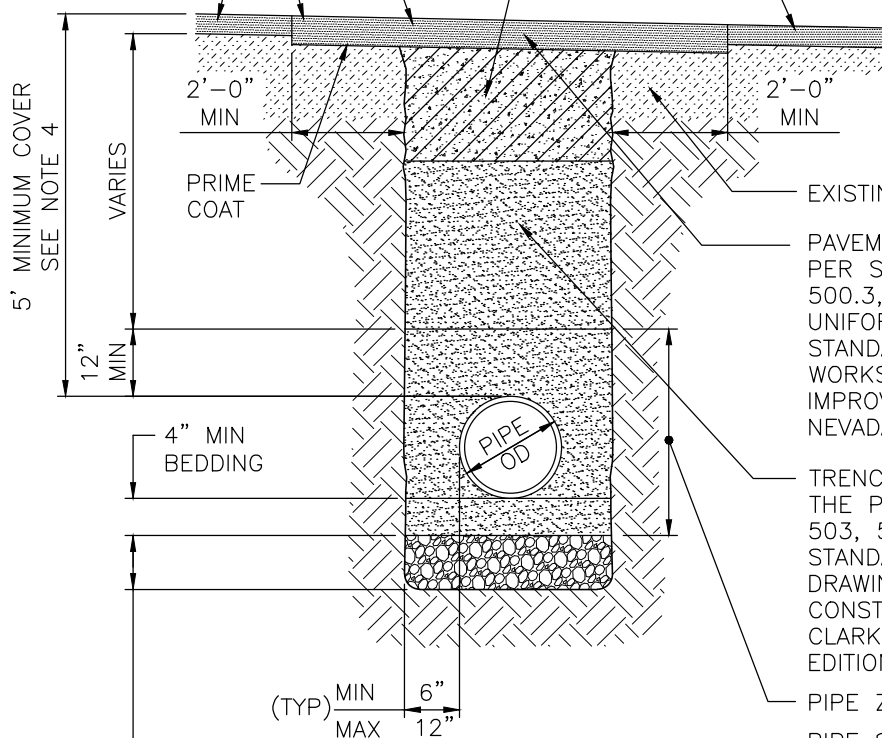

EXISTING AGGREGATE BASE MATERIAL

PAVEMENT REPLACEMENT REQUIREMENTS **
PER STANDARD DRAWINGS 500.1, 500.2,
500.3, 500.4 AND 500.5 OF THE
UNIFORM STANDARD SPECIFICATIONS AND
STANDARD DRAWINGS FOR PUBLIC
WORKS CONSTRUCTION OFF-SITE
IMPROVEMENTS, CLARK COUNTY AREA
NEVADA, LATEST EDITION.

TRENCH BACKFILL REQUIREMENTS ABOVE **
THE PIPE ZONE PER STANDARD DRAWINGS
503, 503.1, AND 503.2 OF THE UNIFORM
STANDARD SPECIFICATIONS AND STANDARD
DRAWINGS FOR PUBLIC WORKS
CONSTRUCTION OFF-SITE IMPROVEMENTS,
CLARK COUNTY AREA NEVADA, LATEST
EDITION.

PIPE ZONE (INCLUDING BEDDING)

PIPE SIZES 24" AND SMALLER:
TYPE II AGGREGATE BASE BACKFILL
COMPACTED TO 90% OF MAX DENSITY,
OR CLSM CLASS I


PIPE SIZES LARGER THAN 24" CLSM
CLASS I ONLY (SEE SPECS)

TRENCH BACKFILL - PAVED AREAS

NOT TO SCALE

PL02-1

121119



**

LIST ONLY THE UNIFORM STANDARD DRAWING (USD) NUMBER AS DETERMINED
BY THE DESIGN ENGINEER BASED ON THE PROJECT REQUIREMENTS. IF THE
PROJECT REQUIRES MORE THAN ONE USD TO BE LISTED, LIST THE LIMITS
FOR EACH USD BY STATIONING IN A TABLE WITH THE TRENCH SECTION
ABOVE OR IDENTIFY THE USD LIMITS AREAS ON ALL CIVIL PLANS.