


REMOVABLE CONC SLAB (TYP OF 2)
SEE SECTION (X) (PL03-C)

OPENING FOR VALVE OPERATORS
SEE DETAIL (X) (PL05-7)

SEALANT (TYP),
SEE SECTION (X) (PL03-C)

BACKFILL LIMITS OF VAULT EXCAVATION
WITH TYPE II AGGREGATE BASE. COMPACT
TO 90% OF MAX DENSITY, UNLESS
OTHERWISE SPECIFIED (TYP).

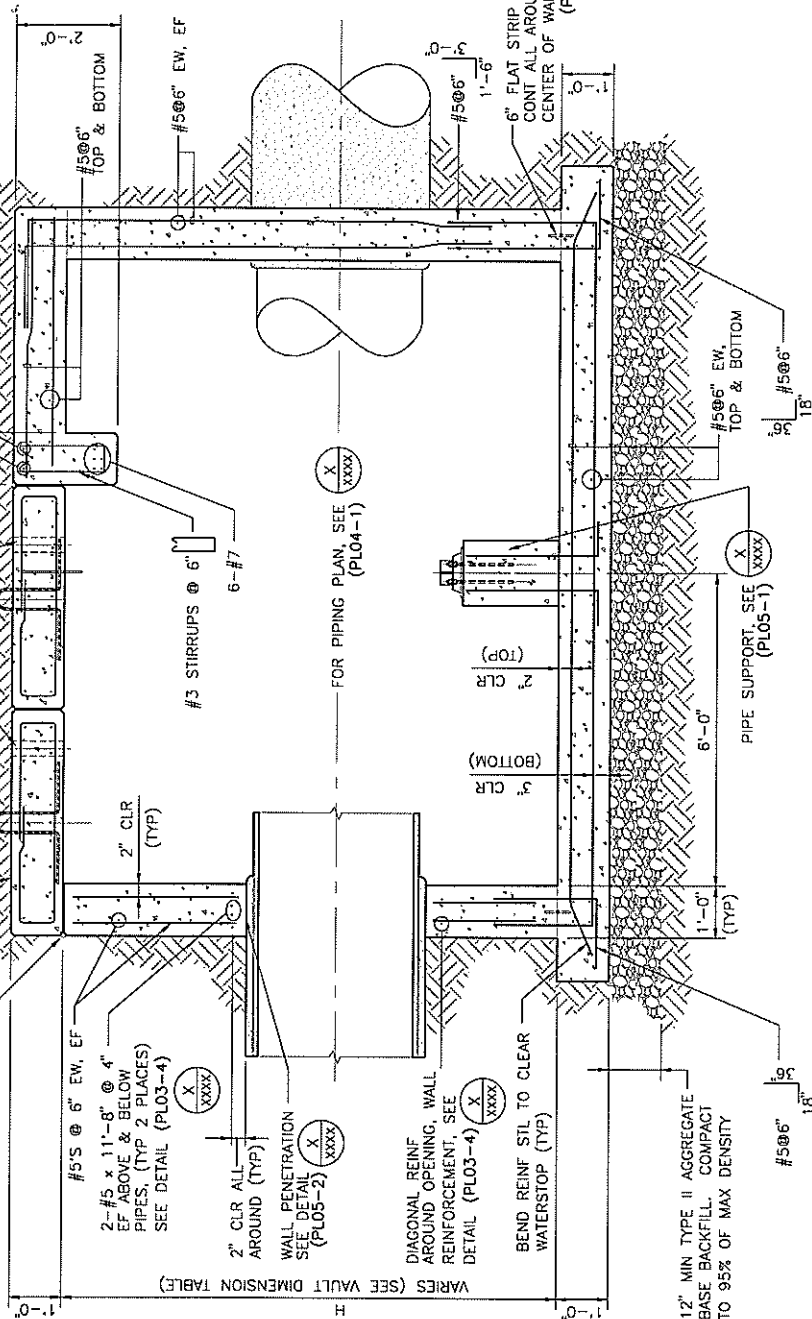

DESIGNER NOTES:

1. EACH VAULT SHOWN ON THE PIPELINE PLAN SHALL BE DETAILED WITH A STRUCTURAL PLAN, A MECHANICAL PIPING PLAN AND ALL OTHER REQUIRED SECTIONS AND DETAILS. THE VAULT PLANS SHALL INDICATE THE PIPE LINE STATION REFERRED TO THE VAULT STATIONING POINT, THE VAULT ORIENTATION TO NORTH, THE LOCATION AND PLAN ORIENTATION OF ALL OF THE VAULT APPURTENANCES AND THE MANHOLE ACCESS COVER.
2. EACH VAULT PLAN, SECTIONS AND DETAILS SHALL INDICATE ALL LAYOUT DIMENSIONS AS DETERMINED BY THE DESIGN ENGINEER OR AS REFERENCED TO DIMENSIONS ON THE "VAULT DIMENSION TABLE" PL03-6 AND THE "PIPE LOCATION TABLE" PL03-5 IN THESE STANDARD DETAILS.

(DESIGNER NOTES TO BE DELETED FROM DRAWING)

SECTION

SCALE: 1/2" = 1'-0" PL03-A 063006