


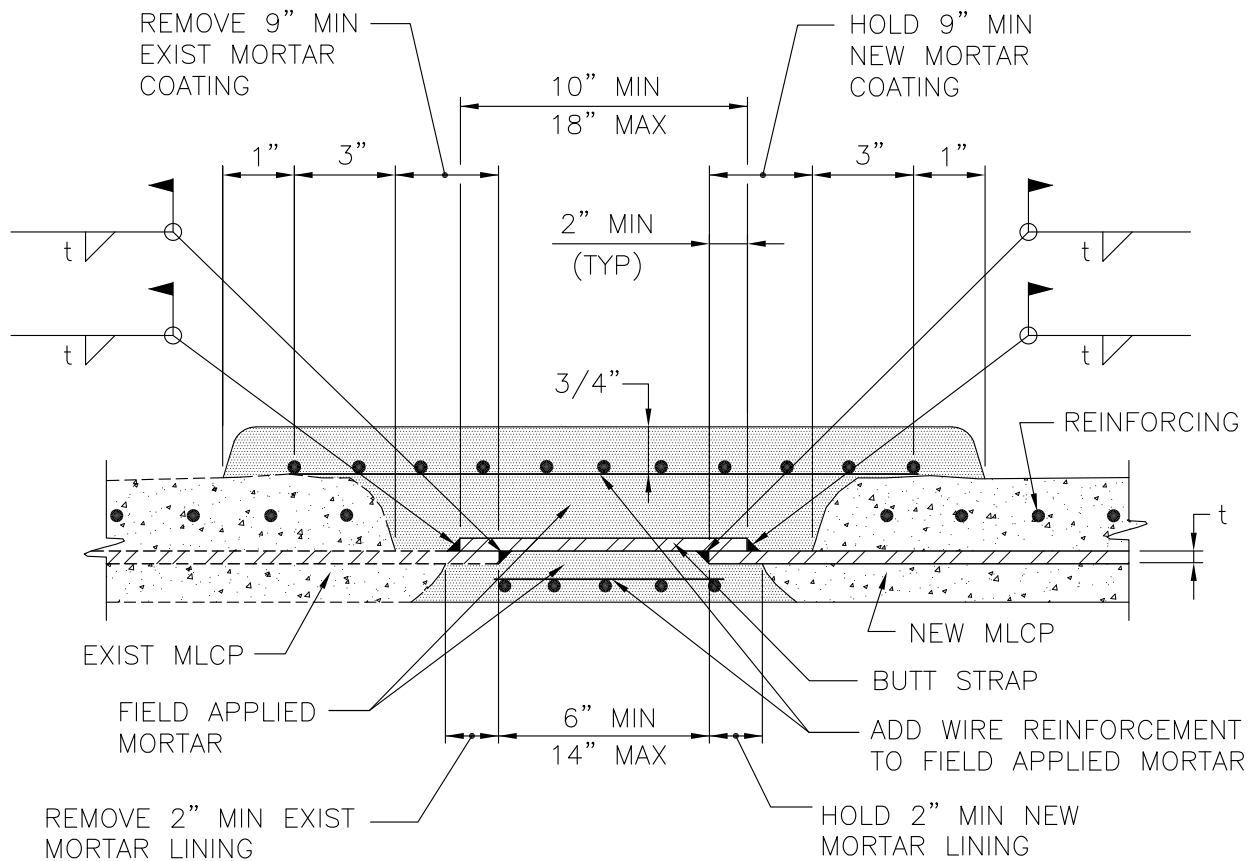

NOTES:

1. SEE SPECS SEC 33 11 50 FOR MORTAR LINED AND COATED STEEL PIPE.
2. PERFORM PNEUMATIC TESTING OF JOINT WELDS IN ACCORDANCE WITH SPECS SEC 33 13 02.

BUTT STRAP JOINT AT MLCP CONNECTIONS TO EXISTING MLCP

NOT TO SCALE

PL01-6

042922

