


SECTION A
NOT TO SCALE

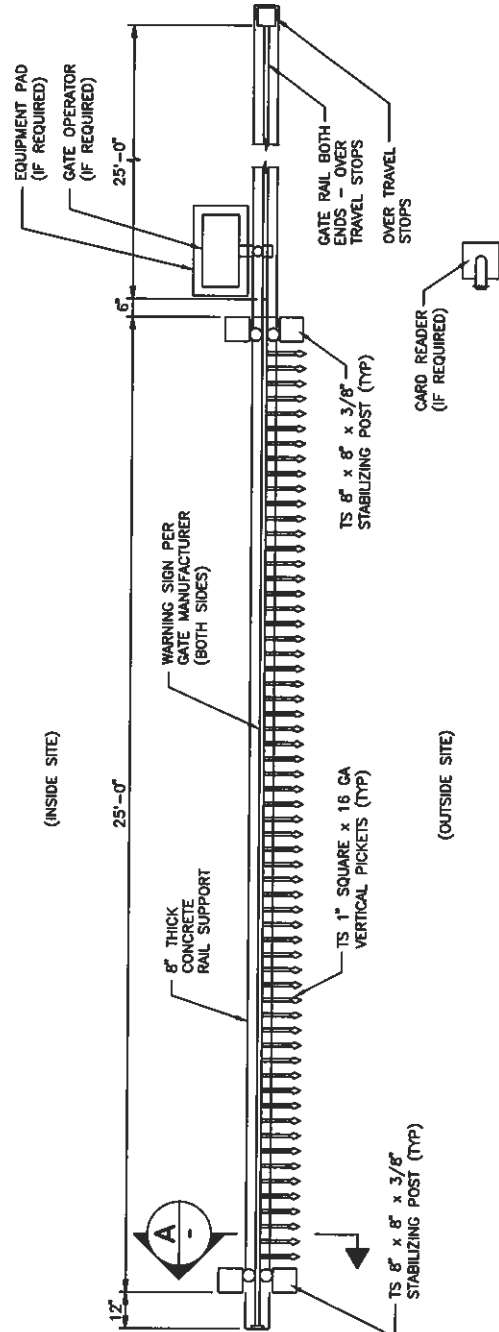

- NOTES:**
1. INSTALLATION OF GATE SHALL BE IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
 2. INSTALL EQUIPMENT PAD TO ALLOW FOR ELECTRICAL OPERATOR CONDUITS IF REQUIRED. SIZE DETERMINED BY OPERATOR MANUFACTURER.

SLIDE GATE DETAIL
NOT TO SCALE WE06-5 110309