


NOTES:

1. FINAL RIM ELEVATION TO BE 1/8" TO 1/4" BELOW FINAL STREET GRADE.
2. MORE STRINGENT INSTALLATION REQUIREMENTS MAY BE IMPOSED BY THE ENTITY HAVING THE JURISDICTION OVER THE TRAFFIC BOX INSTALLATION LOCATION.
3. CONTRACTOR TO FORM CONCRETE COLLAR IN UNIMPROVED AREAS WITH SONOTUBE AND REMOVE PRIOR TO BACKFILL INSTALLATION (TYP).
4. SEE SPECIFICATIONS FOR ALL APPROVED PRODUCTS AND ADDITIONAL REQUIREMENTS.
5. EXOTHERMICALLY BOND THE GROUND ELECTRODE 4/0 COPPER CABLE TO THE GROUNDING GRID.
6. CONCRETE COLLAR REQUIRED TO MEET H20 TRAFFIC RATING.

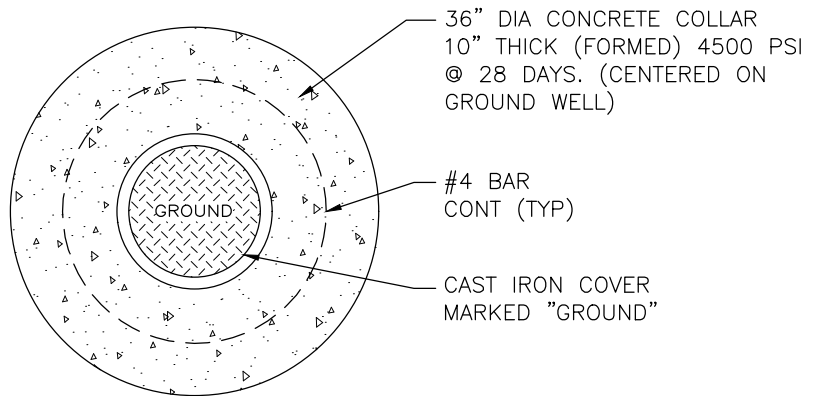

GROUNDWELL SYSTEM

NOT TO SCALE

E06-6

041823

