SECURITY ANNUNCIATOR PANEL	(G)	ANNUNCIATOR POWER
	(W)	ARMED
	(R)	ZONE 1 – CONTROL BUILDING DOOR
	(R)	ZONE 1 – CONTROL BUILDING OVERHEAD DOOR
	(R)	ZONE 1 – CONTROL BUILDING ELECTRIC ROOM DOOR
	(R)	ZONE 2 – DISINFECTION ROOM DOOR
	(R)	ZONE 2 – DISINFECTION OVERHEAD DOOR
	(R)	ZONE 2 – SPARE
	(R)	ZONE 3 – NORTH OUTLET VALVE VAULT HATCH
	(R)	ZONE 3 – SOUTH OUTLET VALVE VAULT HATCH
	(R)	ZONE 3 – UNDERDRAIN VAULT HATCH
	(R)	ZONE 3 – NORTH BASIN ACCESS HATCH
	(R)	ZONE 3 – SOUTH BASIN ACCESS HATCH
	(R)	ZONE 3 – NORTH BASIN LEVEL INST ENCLOSURE DOOR
	(R)	ZONE 3 – SOUTH BASIN LEVEL INST ENCLOSURE DOOR
	(R)	ZONE 3 – INLET/CHECK VALVE VAULT ACCESS HATCH
	(R)	ZONE 3 – NORTH BASIN MIXER NO. 1 ACCESS HATCH
	(R)	ZONE 3 – NORTH BASIN MIXER NO. 2 ACCESS HATCH
	(R)	ZONE 3 – SOUTH BASIN MIXER NO. 3 ACCESS HATCH
	(R)	ZONE 3 – SOUTH BASIN MIXER NO. 4 ACCESS HATCH
	(R)	ZONE 3 – SPARE
	(R)	ZONE 3 – SPARE
	(R)	ZONE 3 – SPARE
	(R)	ZONE 3 – SPARE

ZONE 1
(CONTROL BUILDING,
C–SERIES)

ZONE 2
(DISINFECTION,
N–SERIES)

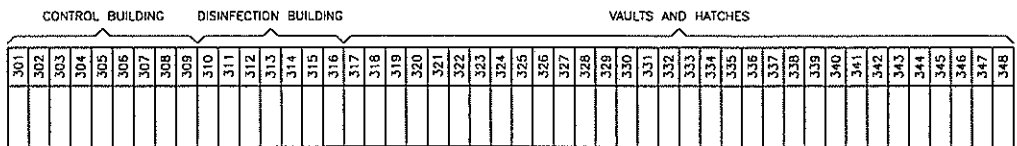ZONE 3
(VAULTS, HATCHES,
V–SERIES)

(x / xxxx)
(E09–8)

SECURITY ANNUNCIATOR MATERIALS

IDEC RELAY RH3BU–DC24V, WITH 3 FORM "C" CONTACTS AND 24VDC COIL (ONE PER DOOR/VAULT/HATCH AND KEY SWITCH)
IDEC RELAY RH1BU–DC24V, WITH 1 FORM "C" CONTACT AND 24VDC COIL, ONE PER ZONE, FOR 120V PLC I/O ISOLATION (GROUP ALL PLC ISOLATION RELAYS TOGETHER AND ISOLATE 120VAC WIRING FROM 24VDC WIRING)
BASE AND DIN RAIL, SUITABLE FOR RELAYS LISTED ABOVE
DIN RAIL MOUNTED TERMINALS, 600V TUBULAR CLAMP TYPE, REFER TO SPECIFICATIONS
HIGH BRIGHTNESS LED, COLOR AS INDICATED ON PANEL, IDI 2191LS (G) AND IDI 2191L1 (R)
NAMEPLATES, ENGRAVED, IN ACCORDANCE WITH SPECIFICATIONS
HOFFMAN ENCLOSURE, NEMA TYPE 12, HINGED, WITH BACK PANEL – 24" x 16" x 6" (MIN)

CONTROL BUILDING   DISINFECTION BUILDING   VAULTS AND HATCHES

| 301 | 302 | 303 | 304 | 305 | 306 | 307 | 308 | 309 | 310 | 311 | 312 | 313 | 314 | 315 | 316 | 317 | 318 | 319 | 320 | 321 | 322 | 323 | 324 | 325 | 326 | 327 | 328 | 329 | 330 | 331 | 332 | 333 | 334 | 335 | 336 | 337 | 338 | 339 | 340 | 341 | 342 | 343 | 344 | 345 | 346 | 347 | 348 |

SECURITY CABINET INTERFACE TERMINAL BLOCK

SECURITY ANNUNCIATOR PANEL II
NOT TO SCALE   E04–6   012507

FOR REFERENCE ONLY