


NOTES:

1. MAKE ALL CONDUIT PENETRATIONS INTO THE BOTTOM OF THE TELEMETRY ENCLOSURE. INSTRUMENTATION WIRING SHALL NOT BE RUN IN THE SAME CONDUIT AS 120VAC CONTROL WIRING.
2. THE TELEMETRY ENCLOSURE EXTERIOR FINISH SHALL BE POLYESTER URETHANE (POWDER COAT) WHITE.
3. DRILL SIX (6) 9/16" HOLES THROUGH ENCLOSURE/PEDESTAL AND INTO CONCRETE PAD. INSTALL ADHESIVE CARTRIDGES, 1/2" x 6" STAINLESS STEEL THREADED ANCHOR RODS WITH TWO (2) STAINLESS STEEL WASHERS AND LEVELING NUTS. INSTALL DRY PACK MORTAR IN ANNULAR SPACE AROUND ENCLOSURE/PEDESTAL AFTER ANCHOR RODS AND LEVELING NUTS ARE INSTALLED

DESIGNER NOTES:
 WHERE THERE IS NO EXISTING SIDEWALK OR IMPROVEMENT THE ELEVATION ON THE FINISHED GRADE OF THE PAD SHALL BE DETERMINED BY THE ENGINEER. PROVIDE ELEVATION AT PAD.
 AN LVWD PERMANENT EASEMENT WILL BE REQUIRED FOR DISTRICT FACILITIES LOCATED OUTSIDE PUBLIC RIGHTS-OF-WAY. SHOW EASEMENT LIMITS ON DETAIL AS REQUIRED.
 WHEN ELECTRICAL PEDESTAL IS TO BE UTILIZED WITHIN PROJECT THEN ELIMINATE THE SOLAR ANTENNA PORTION OF DETAIL.
 WHEN SOLAR ANTENNA IS TO BE UTILIZED WITHIN PROJECT THEN MODIFY "ELECTRICAL SERVICE PEDESTAL" LABELS TO STATE "FUTURE ELECTRICAL SERVICE PEDESTAL" AND SHOW (2) ELECTRICAL STUB-OUTS AT THE FUTURE PEDESTAL LOCATION.

FRONT ELEVATION

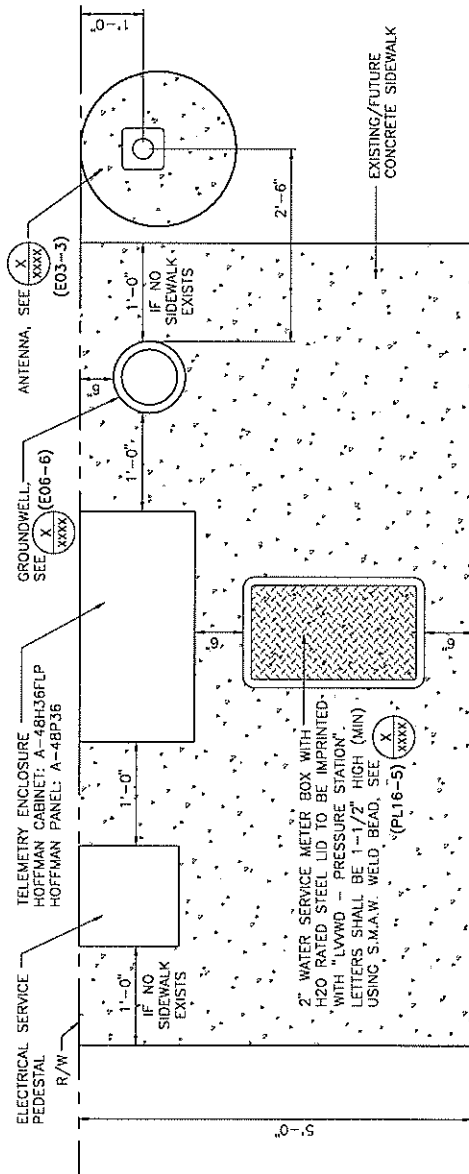

PLAN

PRESSURE STATION ENCLOSURE AND FOUNDATION

NOT TO SCALE

IT01-2 111506

