


NOTES:

1. SCADA INSTRUMENT LOOP NUMBERS SHALL BE PRECEDED BY THE FOLLOWING:
 XXXX SITE NAME
 [NOTE TO ENGINEER: ENTER ASSIGNED ZONE NUMBER FOR XXXX, AND ASSIGNED SITE NAME]
2. THE ASTERISK (*) REFERS TO A SEQUENTIAL NUMBER FOR THE PUMPS IN THE PUMP STATION.
3. [NOTE TO ENGINEER: SEE DGD 24 FOR MOTOR PROTECTION REQUIREMENTS. DATA TO BE PROVIDED BY RVSS OR MULTILIN 489.]
4. REFERENCE ELECTRICAL SCHEMATIC DWG NOS. XXX AND XXX (E14-5A, E14-5B)

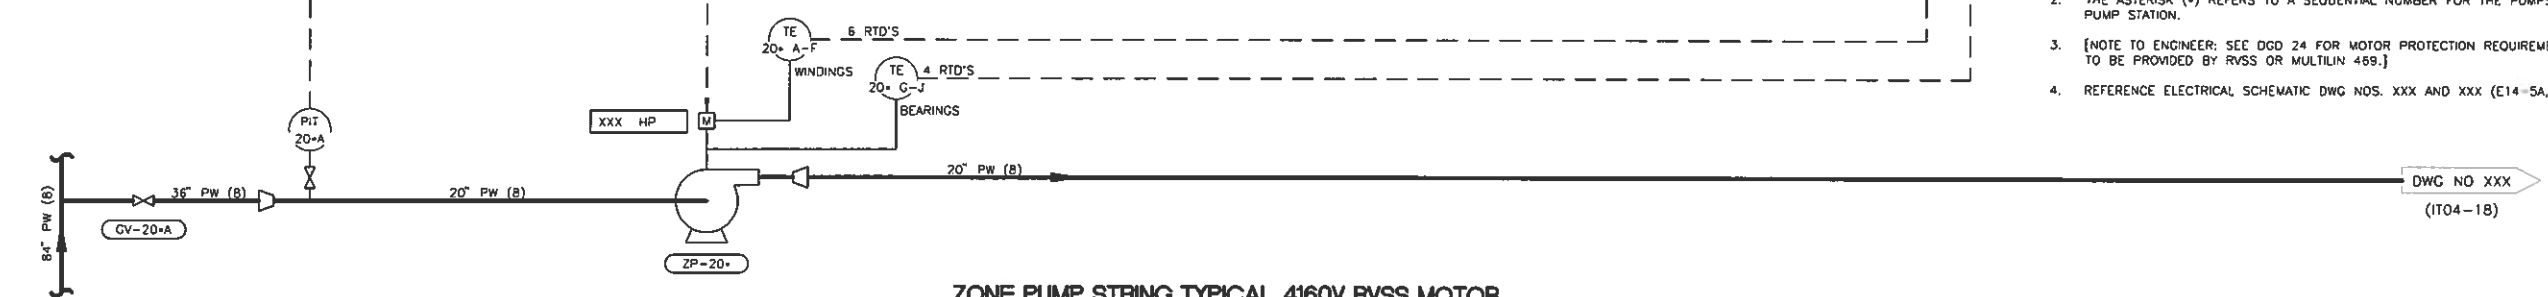

**ZONE PUMP STRING TYPICAL 4160V RVSS MOTOR
 STARTER PROCESS AND INSTRUMENTATION DIAGRAM**
 NOT TO SCALE 1704-16 041907

DWG NO XXX
 (1704-18)