


CROSS-SECTION

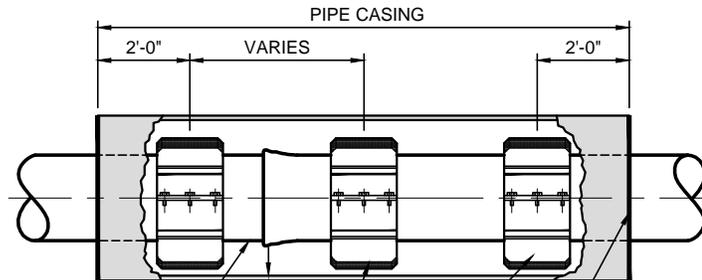

PVC, DI, OR MLC CARRIER PIPE

"X" CASING THICKNESS (TO BE DETERMINED BY ENGINEER) NOT TO EXCEED DEFLECTION OF PIPE

BLOCK OFF CASING END AS REQUIRED FOR FILLING ANNULAR SPACE OR INSTALL RUBBER END SEALS WHEN FILLING ANNULAR SPACE IS NOT REQUIRED

CASING SPACERS, SEE NOTE 4

DI CARRIER PIPE	
8" SPACER WIDTH	
PIPE SIZE	CASING ID
12"	24"
16"	30"
18"	30"
20"	36"
24"	42"
30"	48"
36"	54"

MLC CARRIER PIPE			
8" SPACER WIDTH		12" SPACER WIDTH	
PIPE SIZE	CASING ID	PIPE SIZE	CASING ID
12"	24"	42"	60"
16"	30"	48"	66"
18"	30"	54"	72"
		60"	78"
		66"	84"
		72"	90"

NOTES:

1. PIPE JOINTS INSIDE PIPE CASING TO BE WELDED (MLC) OR RESTRAINED (PVC/DI).
2. INTERIOR OF CASING TO BE GROUND SMOOTH AND LUBRICATED FOR CASING SPACER INSTALLATION.
3. ENTIRE PIPE CASING TO BE INSTALLED LEVEL (6"±) UNLESS OTHERWISE SHOWN ON DRAWINGS. SEE SPECS SEC 33 11 58 FOR FURTHER REQUIREMENTS.
4. PLACEMENT OF CASING SPACERS ON CARRIER PIPE PER MANUFACTURER'S SPECIFICATIONS (TYP)
5. ALL CONDUITS AND FITTINGS INSTALLED WITHIN CASING IN ACCORDANCE WITH SPECS SEC 33 11 58.

CASING ASSEMBLY DETAIL

NOT TO SCALE

PL09-3 022520

