



BLOW-OFF ASSEMBLY

NOTES:

1. IN ORDER TO AVOID UNDUE STRESS ON THE VALVE BOX, VALVE AND BLOW-OFF ASSEMBLY THEY MUST BE PROPERLY SUPPORTED UNTIL THE BACKFILL OPERATION IS COMPLETED.
2. ALL 6" AND 8" STEEL PIPES AND FITTINGS SHALL HAVE CEMENT MORTAR LINING AND COATING.
3. ALL EXPOSED FERROUS SURFACES TO BE COATED IN ACCORDANCE WITH SPECS SEC 33 05 13 AND 09 96 00.

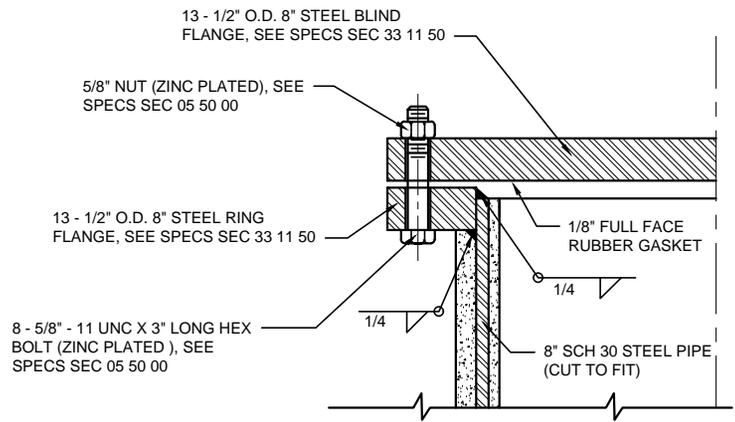

DETAIL 1

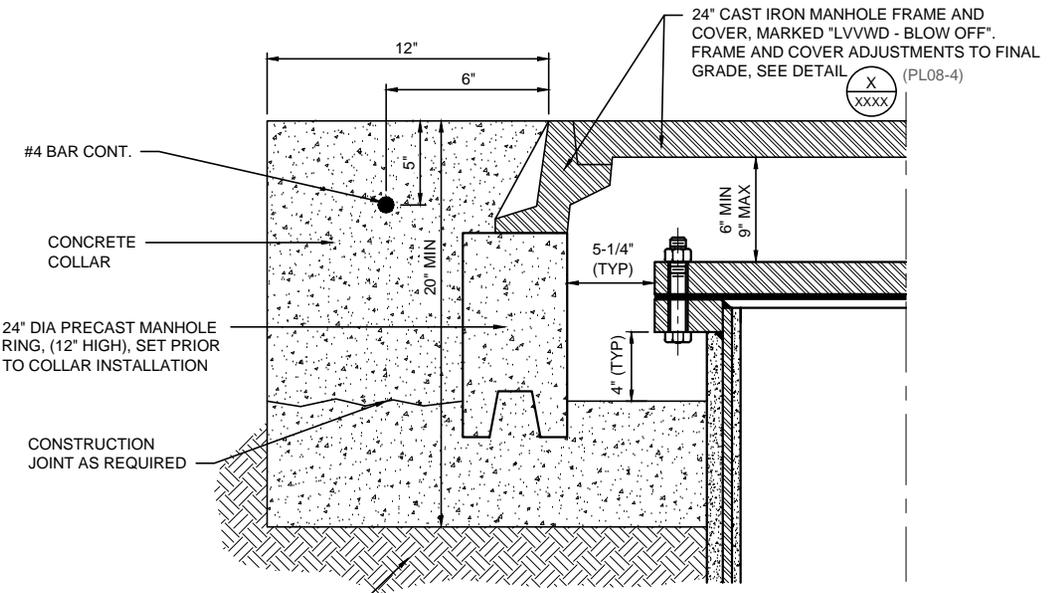

DETAIL 2

6-INCH BLOW-OFF ASSEMBLY AND COVER DETAIL

NOT TO SCALE

PL09-2 011022

