


FUSIBLE PVC PIPE OPTION

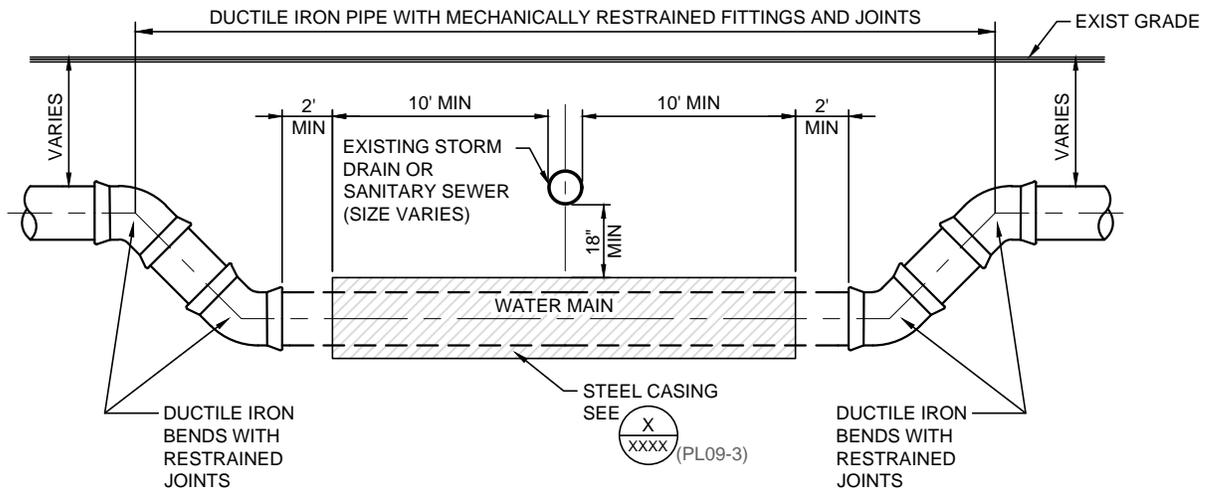

STEEL CASING OPTION

NOTES:

1. IDENTIFY TRANSITION FROM DUCTILE IRON PIPE TO REMAINING PIPE ON PLANS IF PIPE MATERIAL CHANGES.
2. FUSIBLE PVC PIPE REQUIREMENTS, SEE SPEC SEC 33 11 60.
3. PROVIDE SANITARY SEWER SUPPORT PLAN TO CCWRD INSPECTION.
4. CONTACT CCWRD INSPECTIONS IMMEDIATELY UPON UNCOVERING SANITARY SEWER AT 702-622-2867 (CELL) OR 702-668-8205. CCWRD INSPECTOR SHALL BE PRESENT PRIOR TO PERFORMING ANY WORK ASSOCIATED WITH SANITARY SEWER.
5. VERTICAL CLEARANCE LESS THAN 24" SHALL COMPLY WITH DCSWCS, DWG. NO. SD18.
6. BACKFILL OF SEWER LATERAL SHALL NOT OCCUR WITHOUT CCWRD INSPECTOR PRESENCE OR APPROVAL.
7. INSTALL ADDITIONAL RESTRAINED JOINTS UPSTREAM AND DOWNSTREAM OF THE SEWER/STORM CROSSING AS REQUIRED.
8. CLSM, CLASS II ENCASMENT MAY BE ACCEPTED IN LIEU OF FUSIBLE PVC OR STEEL CASING REQUIREMENT ONLY WHEN PRIOR APPROVAL BY LVVWD AND THE SEWER/STORM DRAIN AGENCY JURISDICTION.

EXISTING SEWER/STORM DRAIN MAIN CROSSINGS

NOT TO SCALE

PL02-10 060922

