


APPROXIMATE PIPELINE STATIONING OF TEST STATIONS		
DWG NO	STATION	ADDITIONAL
XX	XXX+XX.XX	XXXXXXX

TEST BOX TO BE LOCATED IN BACK OF EXISTING AND FUTURE CURB IN SIDEWALK

BLUE MARKING TAPE LABELED "CAUTION CATHODIC PROTECTION CABLE BURIED BELOW"

(2) #6 HMWPE TEST LEADS


FINISH GRADE

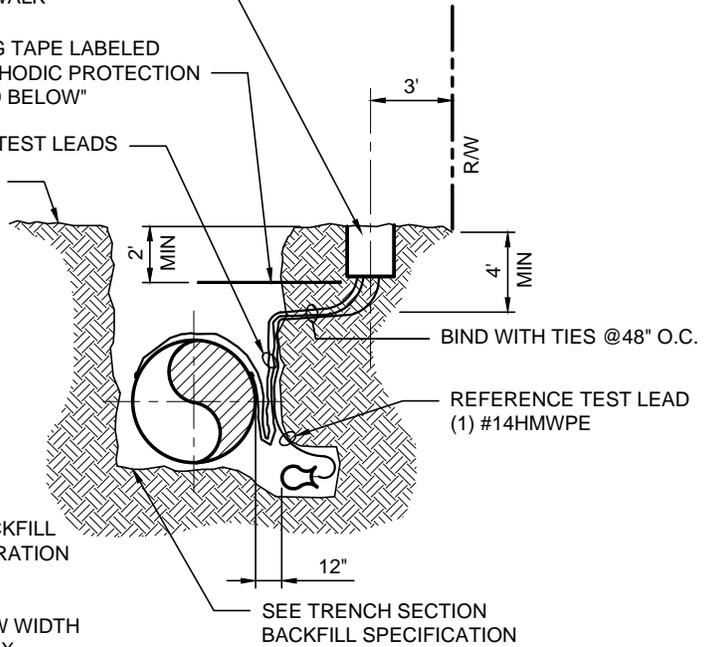

**SECTION A**

**NOTES:**

1. USE ONLY NATIVE SOIL FREE OF ROCKS AND CLODS FOR BACKFILL AROUND CELLS WITH A MINIMUM OF 5 GALS OF WATER SATURATION DURING INSTALLATION. DO NOT USE SAND AS BACKFILL.
2. SUPPLY ENOUGH WIRE FROM EACH LEAD TO REACH FULL R/W WIDTH PLUS FIVE (5) ADDITIONAL FEET. COIL WIRE IN BOTTOM OF BOX.
3. TEST STATION PLACEMENT TO BE PERPENDICULAR TO PIPE, AT INTERSECTIONS, TEST STATION WIRES TO BE PLACED PARALLEL TO PIPE FOR PLACEMENT PERPENDICULAR TO PIPE AFTER ROAD EASEMENT RADIUS.

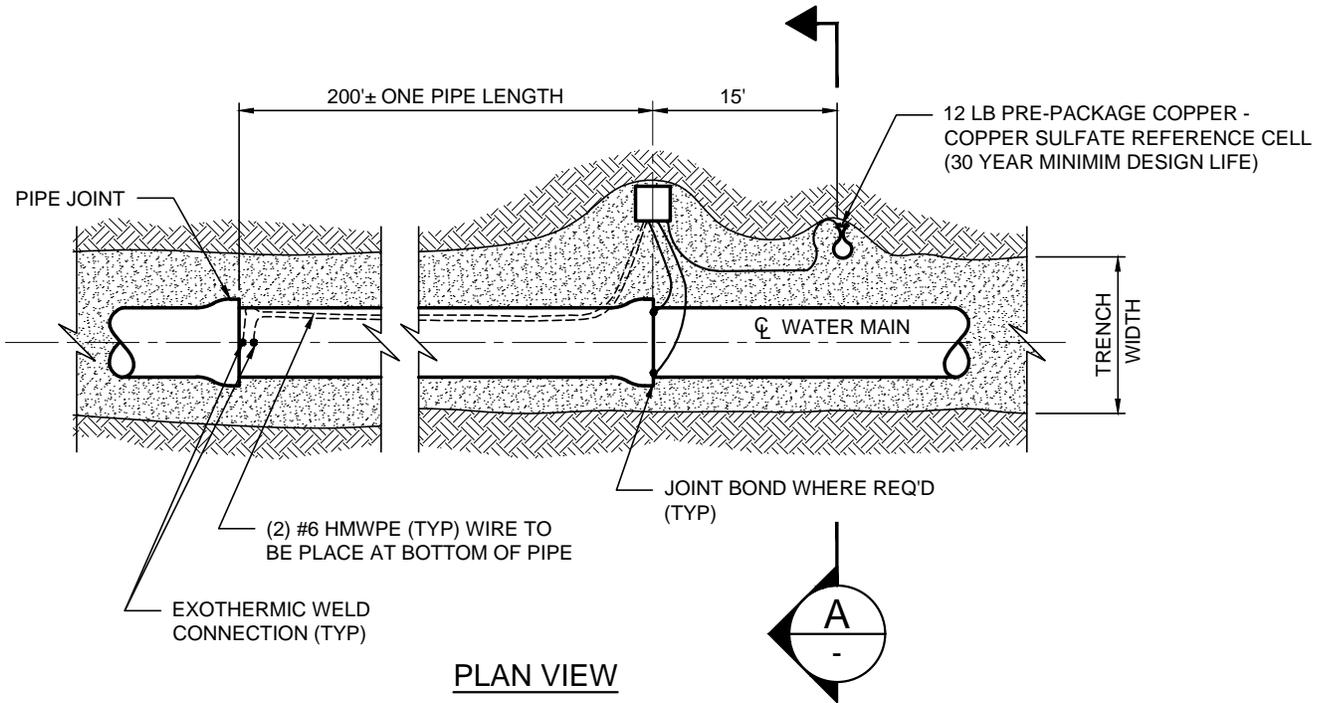

**PLAN VIEW**

**TYPE "T" TEST STATION WITHOUT ANODES**

NOT TO SCALE

PL12-1A 082420

