


1/2" PREMOLDED EXPANSION JOINT WHERE FIRE HYDRANT PAD IS SET AGAINST EXISTING CONCRETE AND AROUND FIRE HYDRANT BARREL

NOTE:
FOR LOCATION OF FIRE HYDRANTS,
AND FIRE HYDRANT PADS. SEE DETAIL (PL15-2)

DESIGNER NOTE:
SEE PL15-5 FOR FIRE HYDRANT
NOTES. DESIGNER NOTES TO
BE DELETED FROM DRAWING

PAD DETAIL

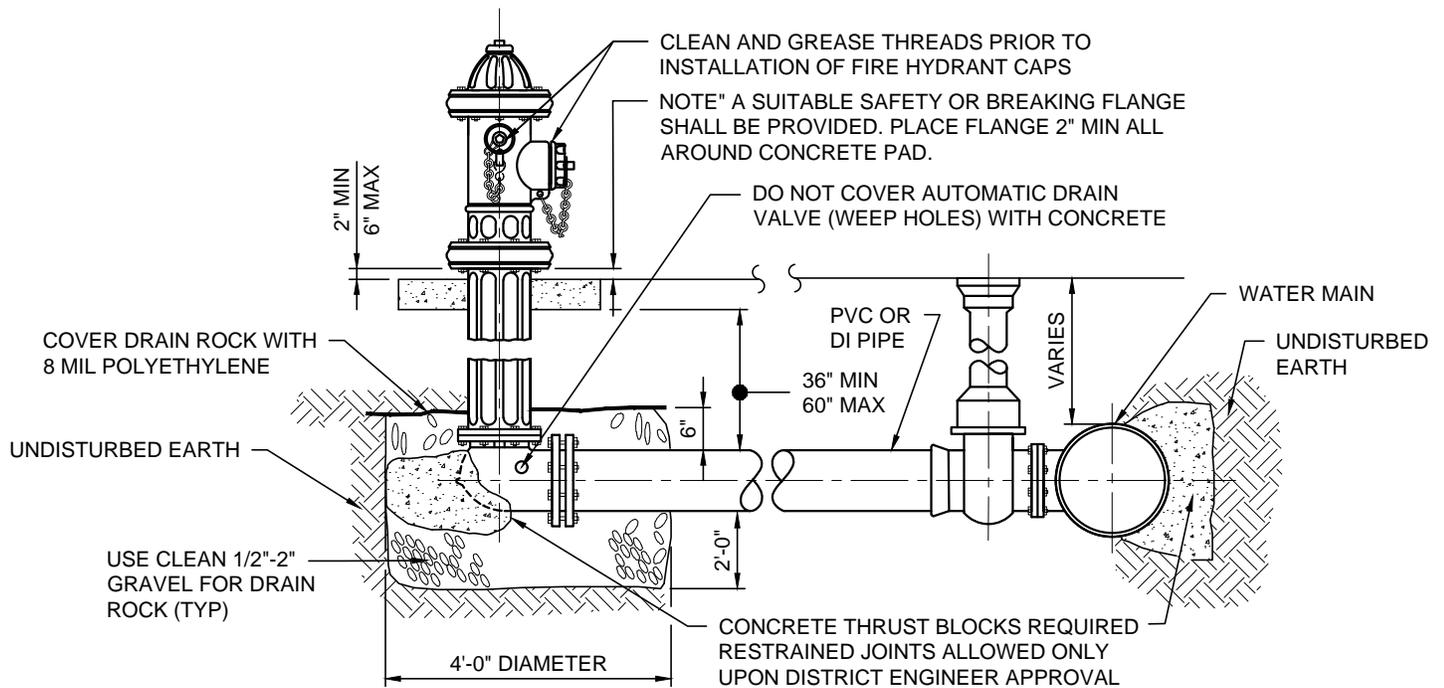

HYDRANT ASSEMBLY DETAIL

FIRE HYDRANT INSTALLATION

SCALE

PL-15-1 070703

