



1/2" PREFORMED EXPANSION JOINT WHERE FIRE HYDRANT PAD IS SET AGAINST EXISTING CONCRETE AND AROUND FIRE HYDRANT BARREL

NOTE:
FOR LOCATION OF FIRE HYDRANTS,
AND FIRE HYDRANT PADS. SEE



DESIGNER NOTE:
SEE PL15-5 FOR FIRE HYDRANT
NOTES. DESIGNER NOTES TO BE
DELETED FROM DRAWING

PAD DETAIL

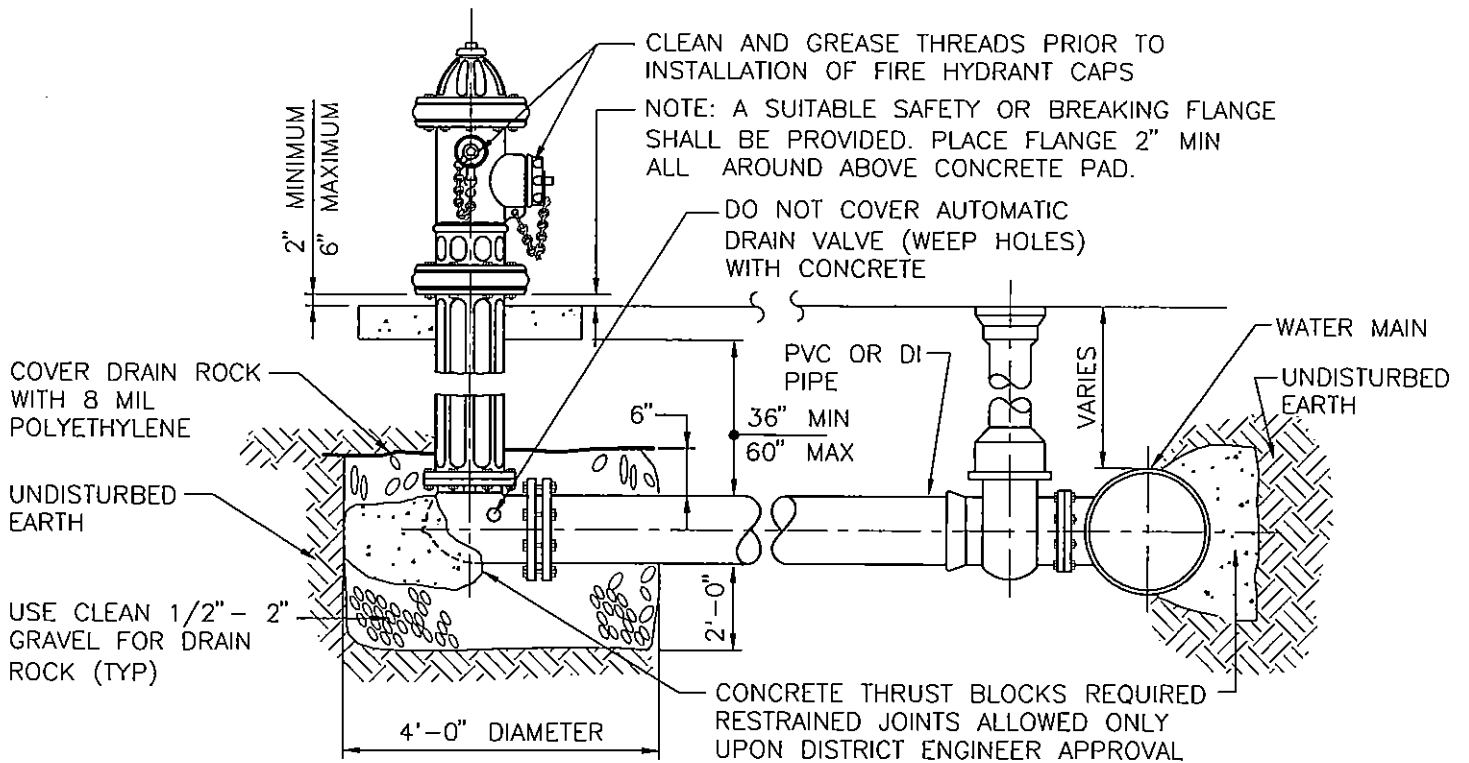

HYDRANT ASSEMBLY DETAIL

FIRE HYDRANT INSTALLATION

NOT TO SCALE

PL15-1 070703

