


FRONT VIEW OF
PLC ENCLOSURE

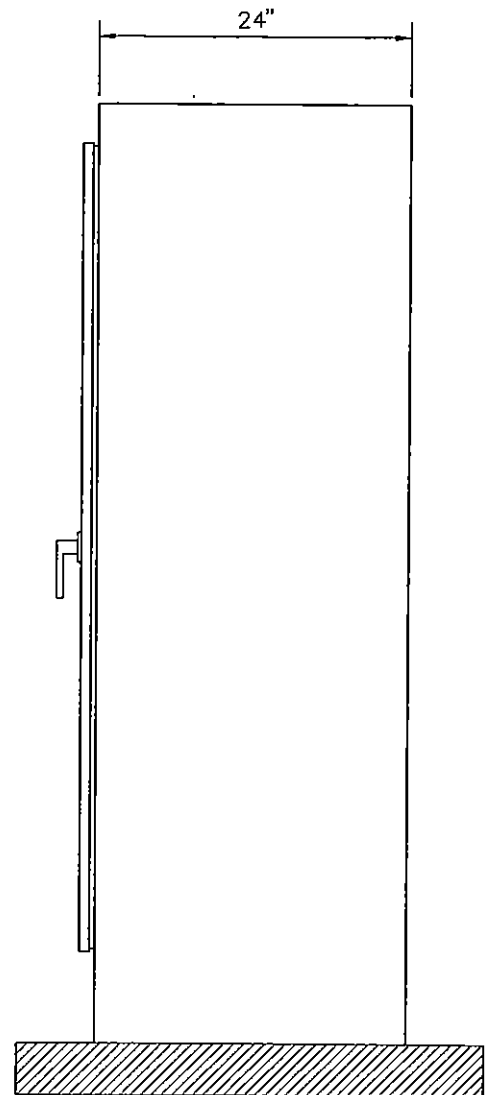

SIDE VIEW OF
PLC ENCLOSURE

NOTES:

1. PLC ENCLOSURE SHALL BE A FREE STANDING NEMA 12 (INDOOR) OR NEMA 4 (OUTDOOR), SINGLE DOOR ENCLOSURE
2. ENCLOSURE FINISHED SHALL BE DONE BY MANUFACTURER:
INTERIOR - STANDARD WHITE ENAMEL (INTERIOR)
EXTERIOR - POLYESTER URETHANE POWDER.
3. HOUSE KEEPING PAD SHALL BE AT LEAST 4 INCH THICK AND 6 INCH WIDE (OVERLAP) FROM ENCLOSURE SIZE.
4. ENCLOSURE BOTTOM SHALL BE PUNCHED FOR THE EXACT NUMBER OF CONDUITS STUBS TO BE USED. PUNCHED HOLE DIAMETER SHALL NOT EXCEED CONDUIT DIAMETER PLUS 1/2 INCH.

FOR EXAMPLE ONLY

FINAL HARDWARE CONFIGURATION WILL VARY ACCORDING TO SPECIFIC CONTRACT REQUIREMENTS. NO ATTEMPT HAS BEEN MADE TO DETAIL THE FINAL HARDWARE CONFIGURATION.

PLC - ENCLOSURE DETAILS

NOT TO SCALE

E07-12 070103

