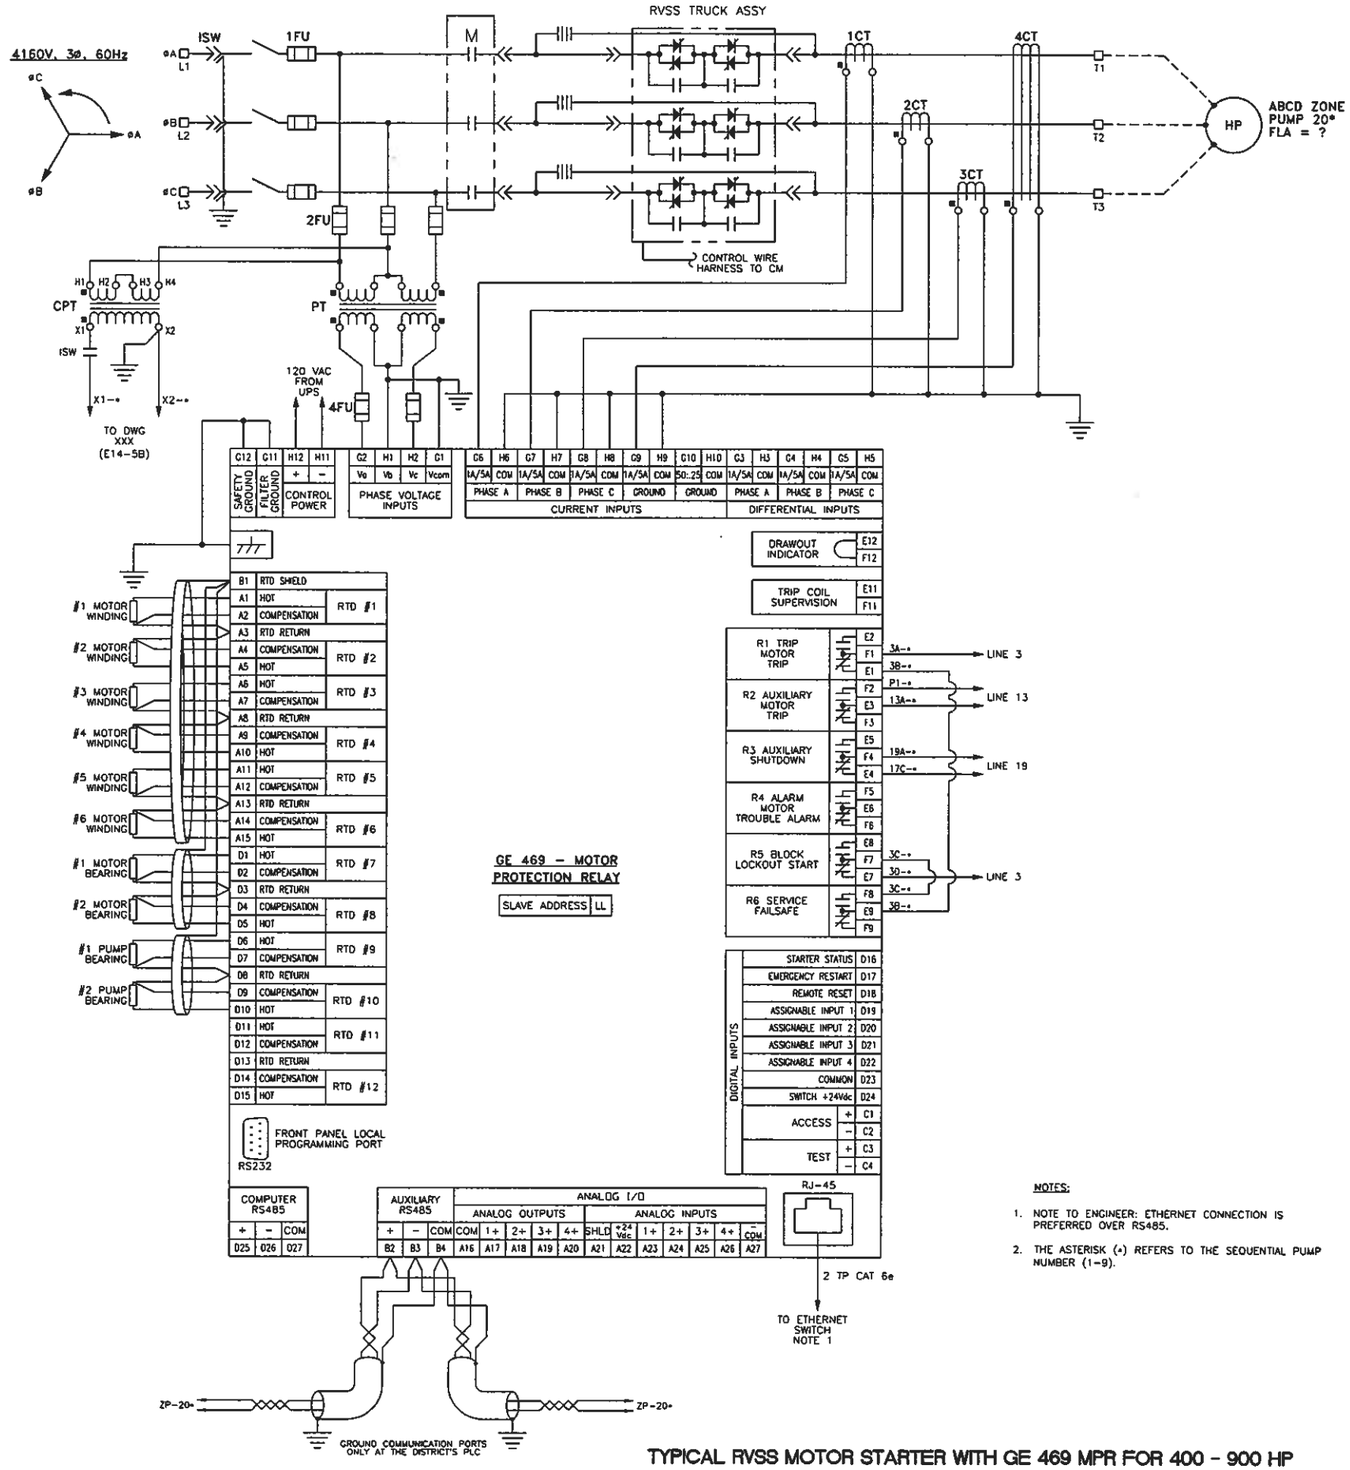


NOTES:

1. NOTE TO ENGINEER: ETHERNET CONNECTION IS PREFERRED OVER RS485.
2. THE ASTERISK (*) REFERS TO THE SEQUENTIAL PUMP NUMBER (1-9).

# TYPICAL RVSS MOTOR STARTER WITH GE 469 MPR FOR 400 - 900 HP AT 4160 VOLTS, 3 DIA, 60HZ SCHEMATIC DIAGRAM I

NOT TO SCALE

E14-5A 041907